


FIG. 1


Sample: TEST vs. CONTROL
Type: Unsupported Nylon
Submitted: 3/23/01
Mode: SEM Cryosection

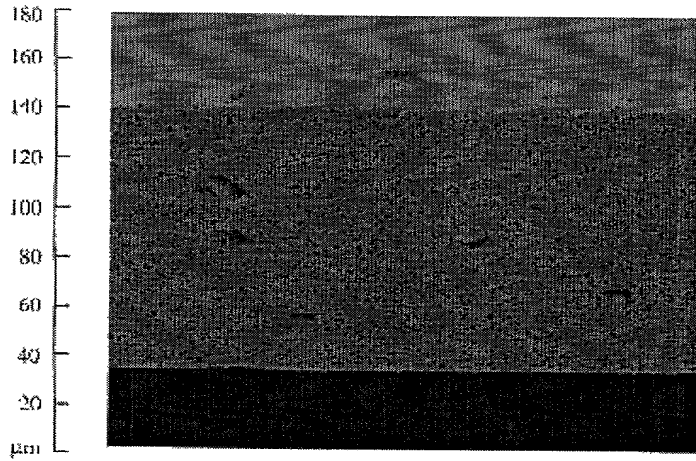

Sample: TEST

500 X

FIGURE 2a

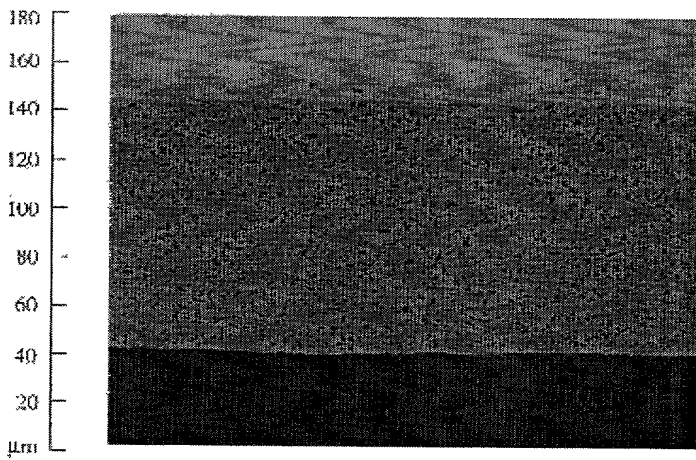

Sample: CONTROL

500 X

FIGURE 2b

Sample: TEST vs. CONTROL
Type: Unsupported Nylon
Submitted: 3/23/01
Mode: SEM Cryosection

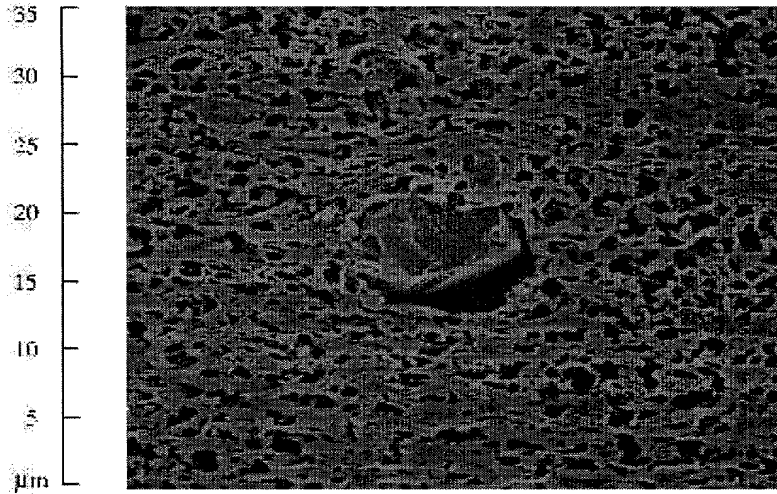


FIGURE 3a.

Sample: TEST

2,500 X


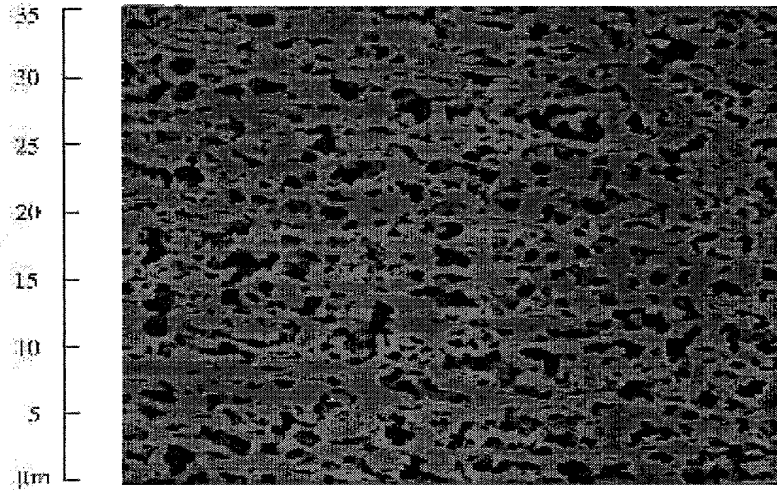


FIGURE 3b

Sample: CONTROL

2,500 X


Sample: TEST vs. CONTROL
Type: Unsupported Nylon
Submerged: 3/23/01
Mode: SEM Cryosection

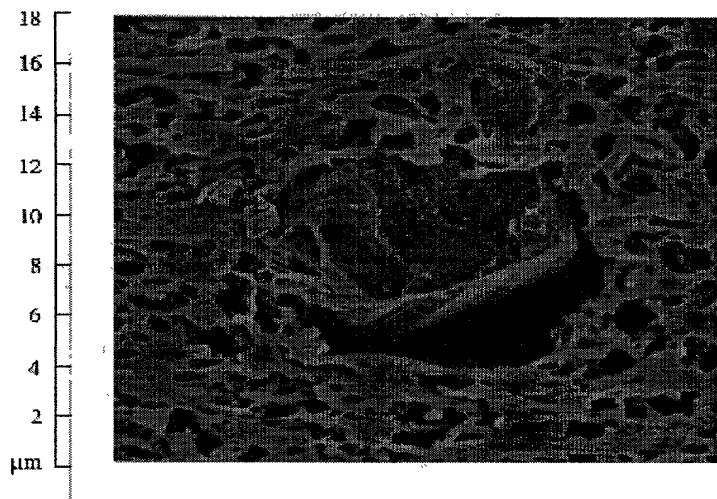

Sample: TEST

5,000 X

FIGURE 4a

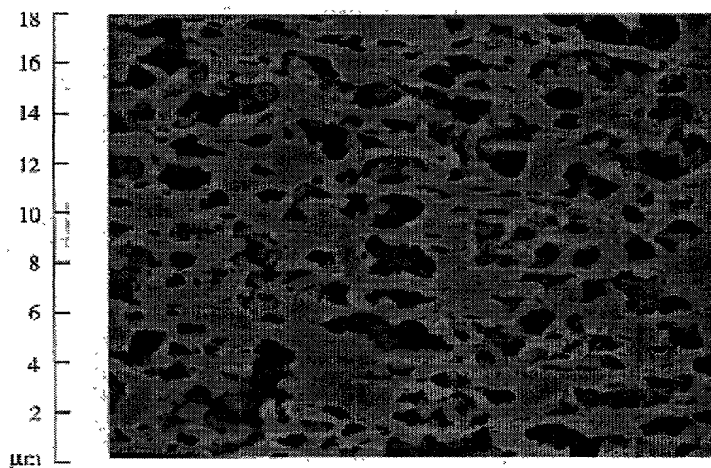

Sample: CONTROL

5,000 X

FIGURE 4b

Figure 5

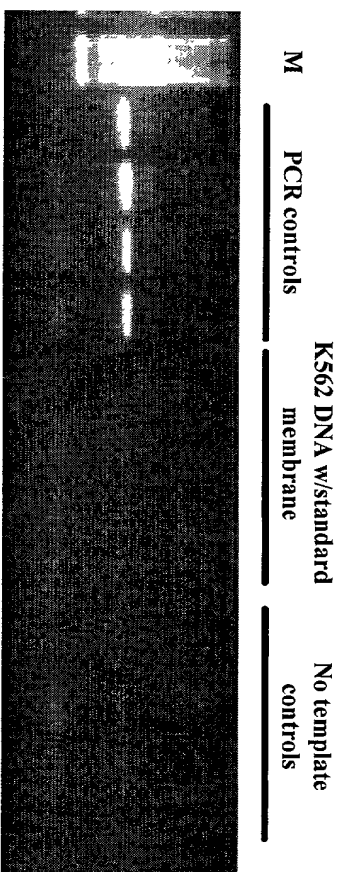


Figure 6

